

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan


“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 11833 (1986): Specification for dry powder fire extinguisher for metal fires [CED 22: Fire Fighting]

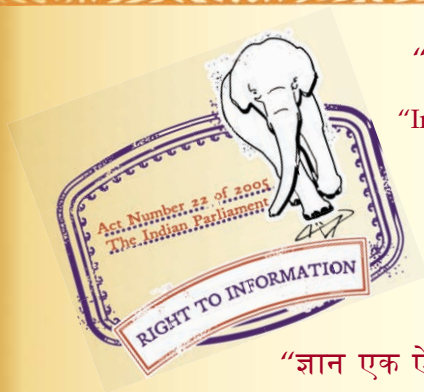

“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



IS : 11833 – 1986
Reaffirmed 2007

Indian Standard

SPECIFICATION FOR
DRY POWDER FIRE EXTINGUISHER FOR
METAL FIRES

(First Reprint OCTOBER 1996)

UDC 614.844.1

© *Copyright* 1987

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Indian Standard

SPECIFICATION FOR DRY POWDER FIRE EXTINGUISHER FOR METAL FIRES

Fire Fighting Sectional Committee, BDC 22

<i>Chairman</i>	<i>Representing</i>
SHRI G. B. MENON	Gujarat Electricity Board, Vadodara
<i>Members</i>	
LT-COL V. R. BANAHATI	Ministry of Defence (DGI)
SHRI S. R. BANSAL	Steel Authority of India Ltd (Bokaro Steel Plant), Bokaro Steel City
SHRI B. L. CHAUDHRY	Oil and Natural Gas Commission, Dehra Dun
SHRI B. K. SIPPY (<i>Alternate</i>)	West Bengal Fire Services, Government of West Bengal
SHRI K. K. DAS GUPTA	State Bank of India, Bombay
SHRI S. M. DESAI	Central Industrial Security Force, Ministry of Home Affairs
DEPUTY INSPECTOR GENERAL (FIRE)	
ASSISTANT INSPECTOR GENERAL (FIRE) (<i>Alternate</i>)	
DEPUTY INSPECTOR GENERAL (RPSF)	Ministry of Railways
ASSISTANT SECURITY OFFICER (FIRE), NORTHERN RAILWAY (<i>Alternate</i>)	
SHRI S. K. DHIERI	Municipal Corporation of Delhi (Delhi Fire Service), Delhi
SHRI R. K. BHARDWAJ (<i>Alternate</i>)	
SHRI R. R. DHOBLEY	Bhabha Atomic Research Centre, Bombay
DIRECTOR	Home Department (Fire Service), Government of Tamil Nadu
DEPUTY DIRECTOR (<i>Alternate</i>)	
DIRECTOR GENERAL OF FIRE SERVICES	Home (Police Department), Government of Andhra Pradesh
DEPUTY DIRECTOR (FIRE SERVICES) (<i>Alternate</i>)	
FIRE ADVISER	Ministry of Home Affairs
SHRI J. S. JAMSHEDJI	Steelage Industries Ltd (Minimax Division), Bombay
SHRI C. GNANRAJ (<i>Alternate</i>)	

(Continued on page 2)

© Copyright 1987

BUREAU OF INDIAN STANDARDS

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

(Continued from page 1)

<i>Members</i>	<i>Representing</i>
SHRI P. KHANNA SHRI S. N. KUNDU MANAGING DIRECTOR	Jaya Shree Textiles and Industries, Rishra Fire and Safety Appliances Co, Calcutta Avon Services (Production and Agencies) Pvt Ltd, Bombay
TECHNICAL EXECUTIVE (<i>Alternate</i>) SHRI P. N. MEHROTRA	The Institution of Fire Engineers (India), New Delhi
SHRI B. R. MEHTA (<i>Alternate</i>) BRIG S. A. MOHILE SHRI A. K. SURI (<i>Alternate</i>) SHRI M. MUKHERJI	Ministry of Defence (R & D) Steel Authority of India Ltd (Rourkela Steel Plant), Rourkela
SHRI C. D. SHARMA (<i>Alternate</i>) SHRI V. B. NIKAM	Municipal Corporation of Greater Bombay (Bombay Fire Brigade), Bombay
SHRI H. M. SABADRA SHRI P. H. SETHNA SHRI N. T. PANJWANI (<i>Alternate</i>) SHRI B. J. SHAH SHRI A. M. SHAH (<i>Alternate</i>) SHRI CHANDRAKANT M. SHAH SHRI M. H. SHAH (<i>Alternate</i>) SHRI R. C. SHARMA	Reliable (Fire Protection) Industries, Bombay Kooverji Devshi and Co (P) Ltd, Bombay Newage Industries, Surendranagar (Gujarat) Zenith Fire Services, Bombay Directorate General of Supplies and Disposals, New Delhi
SHRI D. S. NARESH (<i>Alternate</i>) SHRI T. P. SHARMA SHRI A. K. GUPTA (<i>Alternate</i>) SHRI D. K. SIKKAR SHRI TARIT SUR SHRI SUSHIL KUMAR	Central Building Research Institute, Roorkee Synthetics and Chemicals Ltd, Bareilly Surex Production and Sales (P) Ltd, Calcutta Directorate General of Technical Development, New Delhi
SHRI J. N. VAKIL SHRI K. RAVI (<i>Alternate</i>) SHRI B. V. WAGLE SHRI G. RAMAN, Director (Civ Engg)	Tariff Advisory Committee, Bombay Urban Development, Public Health and Housing Development, Government of Maharashtra Director General, BIS (<i>Ex-officio Member</i>)

Secretary

SHRI K. M. MATHUR
Joint Director (Civ Engg), BIS

(Continued on page 11)

AMENDMENT NO. 1 MARCH 2002
TO
IS 11833 : 1986 SPECIFICATION FOR DRY POWDER
FIRE EXTINGUISHER FOR METAL FIRES

(*Page 3, clause 0.3*) — Insert the following new clauses after 0.3 and renumber the subsequent clause:

'0.4 A scheme for labelling environment friendly products known to be as ECO Mark has been introduced at the instance of the Ministry of Environment and Forests (MEF), Government of India. The ECO Mark would be administered by the Bureau of Indian Standards (BIS) under the *BIS Act, 1986* as per the Resolution No. 71 dated 21 February 1991 and No. 425 dated 28 October 1992 published in the Gazette of the Government of India. For a product to be eligible for marking with ECO logo, it shall also carry the standard Mark of BIS besides meeting additional optional, environment friendly requirements. For this purpose, the Standard Mark of BIS would be a single mark being a combination of the ISI Mark and the ECO logo. Requirements to be satisfied for a product to qualify for the BIS Standard Mark for ECO friendliness being included in the relevant published standards through an amendment. These requirements are optional; manufacturing units are free to opt for the ISI Mark alone also.

The amendment is based on the Gazette Notification No. 160 dated 1 April 1999 for Fire Extinguishers as environment friendly products published in the Gazette of Government of India.'

(*Page 10, clause 12.2*) — Insert the following new clause after 12.2 and renumber the subsequent clauses:

'13 OPTIONAL REQUIREMENTS FOR ECO MARK

13.1 General Requirements

13.1.1 Any fire extinguisher having BIS Standard Mark qualifies for consideration of ECO Mark.

13.1.2 The products manufacturer must produce the consent clearance as per provision of the *Water (Prevention and Control of Pollution) Act, 1974*, *Water (Prevention and Control of Pollution) Cess Act, 1977* and *Air (Prevention & Control of Pollution) Act, 1981* respectively, along with authorization if required under *Environment (Protection) Act, 1986*, and the Rules made thereunder to the Bureau of Indian Standards while applying for ECO Mark.

Amend No. 1 to IS 11833 : 1986

13.1.3 The products may display in brief the criteria based on which the product has been awarded ECO Mark.

13.1.4 The product may carry along with instructions for proper use so as to maximize product performance with statutory warning, if any, minimize waste and method of safe disposal.

13.1.5 The material used for product packaging (excluding refills) shall be recyclable, reusable or biodegradable.

13.1.6 The product must display a list of critical ingredients in descending order of quantity present in percent by weight. The list of such critical ingredients shall be identified by the Bureau of Indian Standards.

13.2 Specific Requirements

13.2.1 The fire extinguisher shall not contain any Ozone Depleting Substance (ODS) relevant to fire extinguishers industry as identified under the Montreal Protocol (Annex A).

13.2.2 Gas based extinguishing media once discharged in the atmosphere should not have atmospheric life time of more than a year (Annex B).

13.2.3 Chemical used should not have global warming potential (Annex C).

13.2.4 The metallic body and other metal parts of the fire extinguishers shall be free of lead or lead alloys.

13.2.5 The coating used for the metallic part shall not be formulated with mercury and mercury compounds or be tinted with pigments of lead, cadmium, chromium VI and their oxides. Excluded are natural impurities entailed by the production process up to the amount 0.1 percent by weight which are contained in the raw material.

NOTE — CO₂ extinguishers may be permitted till suitable substitutes are available.

ANNEX A
(*Clause 13.2.1*)

**LIST OF OZONE DEPLETING SUBSTANCES (ODS) CONTROLLED
BY MONTREAL PROTOCOL**

<i>Trade Name</i>	<i>ODP</i>
Halon 1211	3.0
Halon 1301	10.0
Halon 2402	6.0
CFC-11	1.0
CFC-12	1.0
CFC-113	0.8
CFC-114	1.0
CFC-115	0.6
CCl ₄	1.1
C ₂ H ₃ Cl ₃	0.1
CFC-13	1.0
CFC-111	1.0
CFC-112	1.0
CFC-211	1.0
CFC-212	1.0
CFC-213	1.0
CFC-214	1.0
CFC-215	1.0
CFC-216	1.0
CFC-217	1.0
Methyl Bromide	0.6

NOTE — ODP values are relative to CFC-II which has been assigned arbitrary value of 1.0..

ANNEX B
(clause 13.2.2)

LIST OF ATMOSPHERIC LIFE TIME OF GAS-BASED AGENTS

<i>Trade Name</i>	<i>Designation</i>	<i>Atmospheric Life Time (Year)</i>
Halon-13001	(CF 31)	<1 day
NAFS III	HCFC (Blend A)	12
FE 25	HCFC-125	36
FE 241	FCFC-124	6
FE 36	HFC-227 fa	250
FE 13	HFC-23	250
FM 200	HFC-227 EA	41
CEA 410	FC-3-1-10	2 600
Halon 1301	Halon 1301	65
Inergen	IG 541	—
Argonite	IG 55	—
Argon	IG 01	—

ANNEX C
(clause 13.2.3)

**LIST OF SUBSTANCES HAVING GLOBAL
WARMING POTENTIAL (GWP)**

<i>Trade Name</i>	<i>GWP (100 year) Vs CO₂</i>
Halon 1301	5 600
Inergen	—
Argonite	—
Argon	—
CEA 410	5 500
FM 200	3 300
FE 13	12 100
FE 36	8 000
FE 241	480
FE 25	3 200
NAFS III	1 450
CF 31	<5

(CED 22)

**AMENDMENT NO. 2 SEPTEMBER 2006
TO
IS 11833 : 1986 SPECIFICATION FOR DRY POWDER
FIRE EXTINGUISHER FOR METAL FIRES**

[Page 10, clause 13, Title (see also Amendment No. 1)]† – Substitute
'ADDITIONAL' for 'OPTIONAL'.

(CED 22)

Reprography Unit, BIS, New Delhi, India

AMENDMENT NO. 3 AUGUST 2007
TO
IS 11833 : 1986 SPECIFICATION FOR DRY POWDER
FIRE EXTINGUISHER FOR METAL FIRES

(Page 5, clause 6) — Insert the following new subclause:

‘6.7 Braided rubber/plastic hose shall be having bursting pressure not less than 50 kg/cm²’.

(CED 22)

AMENDMENT NO. 4 FEBRUARY 2010
TO
IS 11833 : 1986 SPECIFICATION FOR DRY POWDER FIRE
EXTINGUISHER FOR METAL FIRES

(Page 9, clause 11.1) — Substitute the following for the existing:

“Each extinguisher body shall be painted either with epoxy powder coating or synthetic enamel paint. The shade shall be ‘Fire Red’ or ‘Post Office Red’ conforming to Shades No. 536 or 538 of IS 5.

NOTES

1 Whenever epoxy powder coating is applied on the external surface of mild steel body for anti-corrosive treatment, synthetic enamel paint coating is not required.

2 The body of extinguisher shall be of good finish, clear of all burrs and sharp edges.”

(CED 22)

Reprography Unit, BIS, New Delhi, India

Indian Standard

SPECIFICATION FOR DRY POWDER FIRE EXTINGUISHER FOR METAL FIRES

0. FOREWORD

0.1 This Indian Standard was adopted by the Indian Standards Institution on 29 August 1986, after the draft finalized by the Fire Fighting Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 Dry powder fire extinguishers for metal fires (Class D fires) have special characteristics in view of the fact that these extinguishers are filled with dry powder specially suitable for reactive metals and further in view of the high temperatures involved in burning metals, these extinguishers are able to discharge the contents with low velocity so as to prevent blowing away of the burning metallic particles which can be dangerous, creating the fire elsewhere.

0.3 The extinguisher and components shall be designed taking into account the working pressure required to achieve satisfactory performance under maximum pressure achieved at 60°C ambient temperature or maximum pressure likely to be developed in the system with stoppage of powder flow due to obstruction, whichever is more.

0.4 For the the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

1. SCOPE

1.1 This standard lays down the requirements regarding material, shape, construction, chemical charges, anti-corrosive treatment and tests for dry powder fire extinguishers for Class D fires (fires due to burning of metals), of capacities 10, 25, 50, 75 and 100 kg.

*Rules for rounding off numerical values (revised).

2. CAPACITY

2.1 The total capacity of the dry powder extinguisher for metal when filled for the various capacities shall be as under:

<i>Nominal Capacity</i>	<i>Dry Powder Content</i>
kg	kg, Min
10	10
50	50
25	25
75	75
100	100

3. PRINCIPLE

3.1 The method of expulsion of dry powder shall be by means of pressure produced from compressed or liquefied gas from gas cylinder or cartridge attached to the body.

4. MATERIALS

4.1 The material for construction of various parts of the fire extinguisher shall be as given in Table 1.

5. SHAPE AND DIMENSIONS

5.1 The shape of the body shall be cylindrical. The dimensions shall be as follows:

<i>Nominal Capacity</i>	<i>Outside Diameter of Body</i>	<i>Thickness of Shell Material</i>
kg	mm	mm
10	$175 \begin{smallmatrix} + 10 \\ - 5 \end{smallmatrix}$	Not less than 2
$\left. \begin{matrix} 25 \\ 50 \\ 75 \end{matrix} \right\}$	Not more than 750	Not less than 3.15
100	Not more than 750	Not less than 6

NOTE — The minimum thickness of sheet takes into account the minimum thickness required based on bursting formulae and shall not be less than $d/100$, where d is the diameter of body in mm.

5.2 The neck ring shall provide a clear opening of not less than 75 mm (not less than 45 mm in case of 10 kg capacity) and shall have parallel screw threads (see 5.3) for effective length of not less than 25 mm.

5.3 The cap shall be threaded for fixing to the neck ring in the body for not less than 20 mm effective length. The parallel threads shall be

in accordance with IS : 554-1975*. At least 3 holes of not less than 3 mm dia each shall be drilled through the threads of the cap to form vents for release of any pressure remaining in the body during withdrawal of the cap. The centres of the vent holes shall be 6.5 mm from the face of the cap joint washer.

5.4 Discharge hose shall be of the following dimensions:

<i>Capacity of Extinguisher</i>	<i>Diameter</i>	<i>Length</i>
kg	mm	m
10 } 25 }	Not less than 12.5	Not less than 2
50 } 75 } 100 }	Not less than 20	Not less than 3 Not less than 5 Not less than 8

5.5 The wheeled carriage except for 10 kg capacity, shall be as shown in Fig. 1 and the lowest part of the body shall remain not less than 100 mm above ground when in vertical position.

5.6 The drain plug provided shall have an opening of not less than 25 mm diameter except for 10 and 25 kg capacity.

6. CONSTRUCTION (see Fig. 1)

6.1 The body shall be designed and constructed according to IS : 2825-1969†.

6.2 The domed ends of the body shall be without reverse of curvature and shall be dished outwards to a radius not exceeding the internal diameter of the body to which these are fixed.

6.3 Non-ferrous metal parts shall be brazed to the body.

6.4 The wheeled carriage shall be either integral with the body or shall be as a separate carriage with proper locking/seating arrangement to the body.

6.5 A towing handle shall be provided on the body for easy manoeuvrability as per details given in Fig. 1.

6.6 Necessary supporting fixture for hose rest shall be provided on the body.

*Dimensions for pipe threads where pressure tight joints are required on the threads (second revision).


†Code for unfired pressure vessels.

TABLE 1 MATERIALS OF CONSTRUCTION FOR VARIOUS PARTS OF FIRE EXTINGUISHER
(Clause 4.1.2)

Sl. No. (1)	COMPONENT (2)	MATERIAL (3)	CONFORMING TO (4)
1. Body		Mild steel plates	IS : 513 - 1973* (for 10 kg capacity only)
2. Neck ring			IS : 2002-1982†
3. Cap			IS : 226-1975‡
4. Discharge fittings			IS : 1239 (Part 1)-1979§
5. Drain plug		Mild steel seamless tube	Grade LTB-2 of IS : 318-1981
6. Discharge nozzle		a) Leaded tin bronze	Type 1 of IS : 319-1974¶
		b) Extruded brass sections	Grade LTB-2 of IS : 318-1981
		a) Leaded tin bronze	Type 1 of IS : 319-1974¶
		b) Extruded brass sections	Grade LTB-2 of IS : 318-1981
		c) MS plates	Type 1 of IS : 319-1974¶
		a) Aluminium alloy	IS : 226-1975‡
		b) Extruded brass sections	IS : 617-1975**
		c) Leaded tin bronze	Type 1 of IS : 319-1974¶
7. Applicator			Grade LTB-2 of IS : 318-1981
		a) Aluminium alloy	IS : 617-1975**
		b) Aluminium tube	IS : 1285-1975††
		c) Extruded brass	Type 1 of IS : 319-1974¶
		d) Leaded tin bronze	Grade LTB-2 of IS : 318-1981
8. Cap washer		Rubber	IS : 937-1981‡‡
9. Syphon tube		a) Mild steel tube	IS : 3601-1984§§
		b) Brass	Alloy No. 2 of IS : 407-1981
10. Hose		Braided rubber plastic	Having bursting pressure not less than 50 kgf/cm ²

11. Expellent gas cylinder	a) Cartridge	IS : 4947-1985**†
	b) Manganese steel cylinder	IS : 7285-1982***
12. Expellent cylinder discharge valve	—	IS : 3224-1979†††
13. Wheeled carriage	Details given in Fig. 1	

*Specification for cold rolled carbon steel sheets (*second revision*).
 †Specification for steel plates for pressure vessels for intermediate and high temperature service including boilers (*first revision*).
 ‡Specification for structural steel (standard quality) (*fifth revision*).
 §Specification for mild steel tubes, tubulars and other wrought steel fittings: Part 1 Mild steel tubes (*fourth revision*).
 ||Specification for leaded tin bronze ingots and castings (*second revision*).
 ¶Specification for free-cutting brass bars, rods and sections (*third revision*).
 **Specification for aluminium and aluminium alloy ingots and castings for general engineering purposes (*second revision*).
 ††Specification for wrought aluminium and aluminium alloy, extruded round tube and hollow sections (for general engineering purposes) (*second revision*).
 ‡‡Specification for washers for water fittings for fire fighting purposes (*second revision*).
 §§Specification for steel tubes for mechanical and general engineering purposes (*first revision*).
 |||Specification for brass tubes for general purposes (*third revision*).
 ¶¶Specification for gas cartridge for use in fire extinguishers (*second revision*).
 ***Specification for seamless manganese steel cylinders for permanent and high pressure liquefiable gases (*first revision*).
 †††Specification for valve fittings for compressed gas cylinders excluding liquefied petroleum gas (LPG) cylinders (*second revision*).

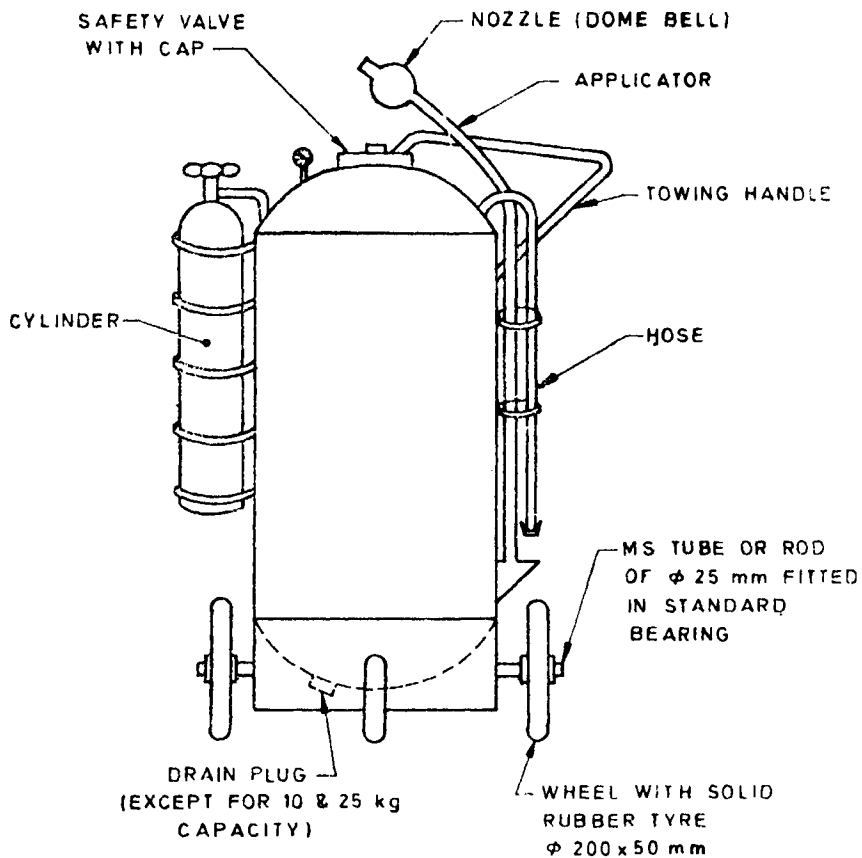

NOTE 1 — For 25 kg and lesser capacity, gas cartridge on outside or inside may be used.

NOTE 2 — For 10 kg capacity, trolley is not needed.

FIG. 1 TYPICAL DETAILS OF DRY POWDER FIRE EXTINGUISHER
FOR METAL FIRES

7. EXPANSION SPACE

7.1 A space shall be provided above dry powder level in the body of the extinguisher. It shall be of sufficient volume to ensure that when discharge nozzle is temporarily closed and the extinguisher is operated at a temperature of $27 \pm 2^\circ\text{C}$, the internal pressure shall not exceed 1.5 MN/m^2 (15 kgf/cm^2) and the body shall not show any sign of leakage.

8. APPLICATOR

8.1 The applicator shall be fitted to the discharge end of the hose by a coupling. The applicator shall consist of an extended pipe, not less than 1 m long, with a dome bell at its end and provided with deflecting vanes so as to sprinkle the powder on the burning reactive metal surface, as a low pressure discharge, to give the performance characteristics stipulated in 12.1.

9. ANTICORROSIVE TREATMENT

9.1 All internal surfaces of the body and other internal parts shall be completely coated with zinc or lead-tin in alloy (tin not less than 10 percent) either by hot dipping process or by electrodeposition process or by phosphating, to a thickness of not less than 0.025 mm. The thickness of the coating shall be measured as per IS : 3203-1982*.

10. DRY POWDER CHARGE

10.1 The dry powder used shall conform to IS : 4861-1984†.

11. PAINTING

11.1 Each extinguisher shall be painted fire red conforming to shade No. 536 of IS : 5-1978‡. All components of trolley and other items other than the fire extinguisher shall be painted with the primer and finishing paints of two coats each.

12. TEST REQUIREMENTS

12.1 The extinguisher when operated with the applicator, at a temperature of $27 \pm 2^\circ\text{C}$ in still weather condition shall be capable of discharging minimum of 85 percent by mass of the actual rated capacity.

*Methods of testing local thickness of electroplated coatings (first revision).

†Specification for dry powder for fighting fires in burning metals (first revision)

‡Colours for ready mixed paints and enamels (third revision).

The contents shall be expelled in the form of steady stream low pressure discharge which shall comply with the following requirements:

<i>Capacity of Extinguisher, kg</i>	<i>Duration, Seconds</i>
10	20 to 30
25	30 „ 40
50	40 „ 50
75	50 „ 60
100	70 „ 80

12.2 The extinguisher shall be tested to an internal hydraulic pressure of 3 MN/m^2 (30 kgf/cm^2) for a period of 5 minutes. During test, it shall not show any sign of leakage. In case of hydraulic burst the mechanical failure shall not occur below 4.5 MN/m^2 (45 kgf/cm^2).

13. MARKING

13.1 Each extinguisher shall be clearly and permanently marked with the following information:

- Name of the manufacturer or trade-mark, if any;
- Method of operation in prominent letters;
- The words 'DRY POWDER EXTINGUISHER FOR METAL FIRE';
- The capacity of the extinguisher in kg;
- The words 'RECHARGE AFTER USE';
- A declaration to the effect that the body of the extinguisher has been tested to a pressure of 3.0 MN/m^2 (30 kgf/cm^2);
- Letter 'D' indicating the suitability for 'Class D' fires;
- Year of manufacture; and
- Working and design pressure.

13.1.1 The extinguisher may also be marked with the Standard Mark.

NOTE — The use of the Standard Mark is governed by the provisions of the Bureau of Indian Standards Act 1986 and the Rules and Regulations made thereunder. The Standard Mark on products covered by an Indian Standard conveys the assurance that they have been produced to comply with the requirements of that standard under a well defined system of inspection, testing and quality control which is devised and supervised by BIS and operated by the producer. Standard marked products are also continuously checked by BIS for conformity to that standard as a further safeguard. Details of conditions under which a licence for the use of the Standard Mark may be granted to manufacturers or producers may be obtained from the Bureau of Indian Standards.

(Continued from page 2)

Fire Fighting Equipment Subcommittee, BDC 22 : 2

Convener

SHRI G. B. MENON

Representing

Gujarat Electricity Board, Vadodara

Members

**DEPUTY INSPECTOR GENERAL
(FIRE)**

**Central Industrial Security Force, Ministry of
Home Affairs**

**ASSISTANT INSPECTOR GENERAL
(FIRE) (Alternate)**

SHRI S. M. DESAI

State Bank of India, Bombay

SHRI V. P. DEWAN

Ministry of Defence (DGI)

LT-COL V. R. BANAHATI (Alternate)

FIRE ADVISER

Ministry of Home Affairs

SHRI P. N. MEHROTRA

**The Institution of Fire Engineers (India), New
Delhi -**

SHRI B. R. MEHTA (Alternate)

BRIG S. A. MOHILE

Ministry of Defence (R & D)

SHRI A. K. SURI (Alternate)

SHRI HARISH SALOT

Vijay Fire Protection Systems Pvt Ltd, Bombay

SHRI P. H. SETHNA

Kooverji Devshi & Co Pvt Ltd, Bombay

SHRI N. T. PANJWANI (Alternate)

SHRI JITENDRA SHAH

Safex Fire Services, Bombay

SHRI D. K. SARKAR

Synthetics & Chemicals Ltd, Bareilly

SHRI J. N. VAKIL

Tariff Advisory Committee, Bombay

SHRI K. RAVI (Alternate)

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002

Telephones: 323 0131, 323 8375, 323 9402

Fax : 91 11 3234062, 91 11 3239399

Telegrams : Manaksanstha
(Common to all Offices)
Telephone

Central Laboratory :

Plot No. 20/9, Site IV, Sahibabad Industrial Area, Sahibabad 201010

8-77 00 32

Regional Offices:

Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002 323 76 17

*Eastern : 1/14 CIT Scheme VII M, V.I.P. Road, Maniktola, CALCUTTA 700054 337 86 62

Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022 60 38 43

Southern : C.I.T. Campus, IV Cross Road, MADRAS 600113 235 23 15

†Western : Manakalaya, E9, Behind Marol Telephone Exchange, Andheri (East),
MUMBAI 400093 832 92 95

Branch Offices::

*Pushpak, Nurmohamed Shaikh Marg, Khanpur, AHMEDABAD 380001 550 13 48

‡Peenya Industrial Area, 1st Stage, Bangalore-Tumkur Road,
BANGALORE 560058 839 49 55

Gangotri Complex, 5th Floor, Bhadbhada Road, T.T. Nagar, BHOPAL 462003 55 40 21

Plot No. 62-63, Unit VI, Ganga Nagar, BHUBANESHWAR 751001 40 36 27

Kalaikathir Buildings, 670 Avinashi Road, COIMBATORE 641037 21 01 41

Plot No. 43, Sector 16 A, Mathura Road, FARIDABAD 121001 8-28 88 01

Savitri Complex, 116 G.T. Road, GHAZIABAD 201001 8-71 19 96

53/5 Ward No.29, R.G. Barua Road, 5th By-lane, GUWAHATI 781003 54 11 37

5-8-56C, L.N. Gupta Marg, Nampally Station Road, HYDERABAD 500001 20 10 83

E-52, Chitaranjan Marg, C-Scheme, JAIPUR 302001 37 29 25

117/418 B, Sarvodaya Nagar, KANPUR 208005 21 68 76

Seth Bhawan, 2nd Floor, Behind Leela Cinema, Naval Kishore Road,
LUCKNOW 226001 23 89 23

Patliputra Industrial Estate, PATNA 800013 26 23 05

T.C. No. 14/1421, University P. O. Palayam, THIRUVANANTHAPURAM 695034 6 21 17

Inspection Offices (With Sale Point) :

Pushpanjali, 1st Floor, 205-A, West High Court Road, Shankar Nagar Square,
NAGPUR 440010 52 51 71

Institution of Engineers (India) Building 1332 Shivaji Nagar, PUNE 411005 32 36 35

*Sales Office is at 5 Chowringhee Approach, P.O. Princep Street,
CALCUTTA 700072 27 10 85

†Sales Office is at Novelty Chambers, Grant Road, MUMBAI 400007 309 65 28

‡Sales Office is at 'F' Block, Unity Building, Narashimaraja Square,
BANGALORE 560002 222 39 71