

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan

“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 1706 (1972): Method for determination of resistance to wear by abrasion of natural building stones [CED 6: Stones]



“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



Indian Standard
**METHOD FOR DETERMINATION OF
RESISTANCE TO WEAR BY ABRASION
OF NATURAL BUILDING STONES**
(First Revision)

Second Reprint JANUARY 1999

UDC 691.21:620.178.162.44

© Copyright 1972

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Indian Standard

METHOD FOR DETERMINATION OF RESISTANCE TO WEAR BY ABRASION OF NATURAL BUILDING STONES (*First Revision*)

Stones Sectional Committee, BDC 6

Chairman

SHRI C. B. L. MATHUR

Representing

Public Works Department, Government of Rajasthan

Members

SHRI K. K. AGRAWALA

Builders' Association of India, Bombay

SHRI K. K. MADHOK (*Alternate*)

SHRI T. N. BHARGAVA

Ministry of Parliamentary Affairs, Shipping & Transport (Roads Wing)

CHIEF ARCHITECT

Central Public Works Department

SHRI G. C. DAS

National Test House, Calcutta

SHRI P. R. DAS (*Alternate*)

DEPUTY CHIEF ENGINEER (B & R)

Public Works Department, Government of Kerala

DR M. P. DHIR

Central Road Research Institute (CSIR), New Delhi

SHRI R. L. NANDA (*Alternate*)

DIRECTOR (CSMRS)

Central Water & Power Commission, New Delhi

DEPUTY DIRECTOR (CSMRS) (*Alternate*)

SHRI M. K. GUPTA

Himalayan Tiles and Marble Pvt Ltd, Bombay

SHRI S. D. PATHAK (*Alternate*)

DR IQBAL ALI

Engineering Research Laboratory, Government of Andhra Pradesh

SHRI A. B. LINGAM (*Alternate*)

SHRI D. G. KADKADE

Hindustan Construction Co Ltd, Bombay

SHRI V. B. DESAI (*Alternate*)

SHRI T. R. MEHANDRU

Institution of Engineers (India), Calcutta

SHRI MOHINDERJIT SINGH

Stonco, New Delhi

SHRI PREM SWARUP

Department of Geology & Mining, Government of Uttar Pradesh

SHRI A. K. AGARWAL (*Alternate*)

DR A. V. R. RAO

National Buildings Organization, New Delhi

DEPUTY DIRECTOR (MATERIALS)

(*Alternate*)

SHRI M. L. SETHI

Department of Geology & Mining, Government of Rajasthan

SHRI Y. N. DAVE (*Alternate*)

LT-COL T. P. SHRIVASTAVA

Directorate General Border Roads, New Delhi

DR B. N. SINHA

Geological Survey of India, Calcutta

(*Continued on page 2*)

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

(Continued from page 1)

<i>Members</i>	<i>Representing</i>
SUPERINTENDING ENGINEER (DESIGNS AND MARINE WORKS)	Public Works Department, Government of Tamil Nadu
DEPUTY CHIEF ENGINEER (I & D) (Alternate)	
SUPERINTENDING ENGINEER (DESIGNS)	Public Works Department, Government of Mysore
SHRI M. V. YOGI	Engineer-in-Chief's Branch, Army Headquarters (Ministry of Defence)
SHRI K. N. SUBBA RAO (Alternate)	
SHRI D. AJITHA SIMHA, Director (Civ Engg)	Director General, ISI (<i>Ex-officio Member</i>)
<i>Secretary</i>	
SHRI K. M. MATHUR	
Assistant Director (Civ Engg), ISI	

Indian Standard
**METHOD FOR DETERMINATION OF
RESISTANCE TO WEAR BY ABRASION
OF NATURAL BUILDING STONES**
(First Revision)

0. FOREWORD

0.1 This Indian Standard (First Revision) was adopted by the Indian Standards Institution on 25 June 1972, after the draft finalized by the Stones Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 Natural building stones used in steps, floorings and pavements of buildings are subject to heavy wear and friction. Their durability under such circumstances can be ensured only when they have adequate hardness or abrasive resistance. This standard gives a laboratory method for ascertaining abrasive values of stones intended for such uses. This standard was first published in 1960 and is being revised to include such abrasants which are indigenously available.

0.3 In the formulation of this standard due weightage has been given to international co-ordination among the standards and practices prevailing in different countries in addition to relating it to the practices in the field in this country.

0.4 For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

1. SCOPE

1.1 This standard lays down the procedure for determination of abrasion resistance (wear resistance) of natural building stones.

*Rules for rounding off numerical values (revised).

2. TEST PIECES

2.1 Test pieces shall be cube specimens of size 7.06 cm, \pm 2 percent (area of each face being 50 cm²) taken from the sample selected. The specimens shall be obtained by saw cutting followed by finishing with grinding wheels. The use of chisel and hammer shall be avoided. All the faces of the specimen shall be made true and parallel by saw cutting and grinding.

2.2 Not less than two test pieces shall be used for conducting the test.

3. ABRADANT

3.1 The abrasants for test shall be emery natural or emery synthetic, grit size 80 and shall conform to IS : 3178-1965*. The minimum hardness value shall be 8.

4. APPARATUS

4.1 Abrasion Testing Machine — The abrasion of specimens shall be carried out in a machine conforming essentially to the requirements described in Appendix A.

4.2 Measuring Instrument — A suitable instrument capable of measuring to an accuracy of 0.01 mm shall be used for determining the change in the thickness of the specimen after abrasion.

NOTE — The arrangement for measurement of thickness with the instrument may be as given in Fig. 1. Shoulders *A* and *B* are at right angles and the base *C* is machined at top to an accuracy of 0.01 mm. The test specimen shall be placed on the base with its wearing surface uppermost and sides in contact with the shoulders. The measuring instrument (or dial gauge) shall be set up firmly so that the contactor slightly presses on the surface of the specimen and the reading of the instrument taken. The position of the dial gauge and the setting of the contactor shall be the same during the subsequent measurement after abrasion.

5. TEST PROCEDURE

5.1 The specimens shall be dried at 110°C for 24 h and then weighed to the nearest 0.1 g. The specimen after initial drying and weighing shall be placed in the thickness measuring apparatus (see 4.2) with its wearing surface uppermost, and the reading of the measuring instrument taken.

The grinding path of the disc of the abrasion testing machine (see Appendix A) shall be evenly strewn with 20 g of the abrasive powder. The specimen shall then be fixed in the holding device with the surface to be ground facing the disc, and loaded at the centre with 30 kg. The

*Specification for abrasive, emery grain.

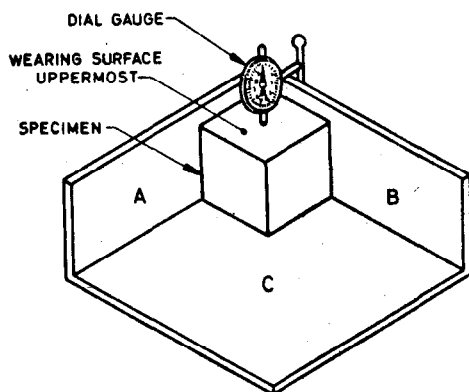


FIG. 1 ARRANGEMENT FOR MEASUREMENT OF THICKNESS

grinding disc shall then be put in motion at a speed of 30 rev/min. After every 22 revolutions, the disc shall be stopped, the abraded stone powder and the remainder of the abrasive powder shall be removed from the disc and fresh abrasive powder in quantities of 20 g applied each time. After 110 revolutions, the specimen shall be turned about the vertical axis through an angle of 90° and then the test continued under the same conditions until 220 revolutions have been completed altogether. The disc, the abrasive powder and the specimen shall be kept dry throughout the duration of the test. After the abrasion is over, the specimen shall be reweighed to the nearest 0.1 g. It shall then be placed in the thickness-measuring apparatus once again in the same manner and the reading taken with the same position and setting of the dial gauge as for the measurement before abrasion.

5.2 Determination of Wear— The wear shall be determined from the difference in readings obtained by the measuring instrument before and after the abrasion of the specimen. The value shall be checked up with the average loss in thickness of the specimen obtained by the following formula:

$$t = 10 \frac{(W_1 - W_2) V_1}{W_1 \times A}$$

where

- t = average loss in thickness in mm,
- W_1 = initial weight in g of the specimen,
- W_2 = final weight in g of the abraded specimen,
- V_1 = initial volume in cm³ of the specimen, and
- A = surface area in cm² of the specimen.

5.3 The test shall be repeated on each one of the six faces of each specimen. Thus not less than twelve values for abrasion will be obtained.

6. REPORT

6.1 The average of the abrasion values obtained in **5.3** shall be reported.


APPENDIX A

(*Clauses 4.1 and 5.1*)

ESSENTIAL REQUIREMENTS OF THE ABRASION TESTING MACHINE

A-1. GENERAL

A-1.1 The testing apparatus shall be a grinding device consisting essentially of a horizontally fixed smooth grinding disc of about 750 mm diameter rotating about a vertical axis and furnished with a replaceable grinding path. The essential features are shown in Fig. 2.

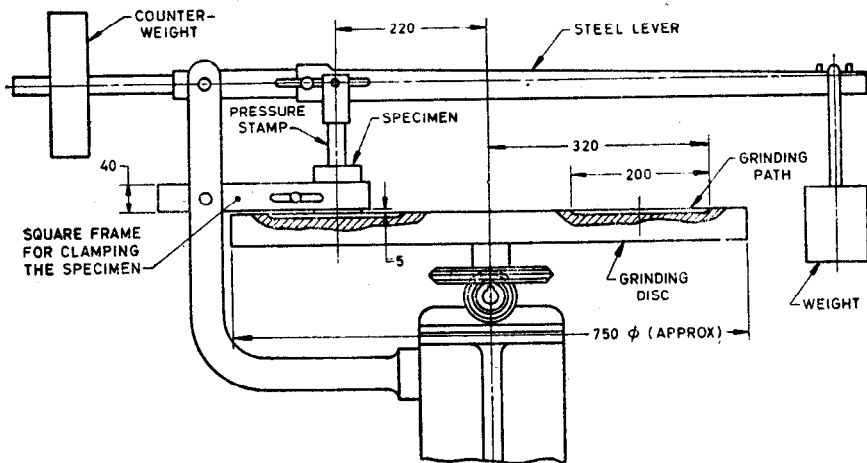

All dimensions in millimetres.

FIG. 2 GENERAL FEATURES OF ABRASION TESTING MACHINE

A-2. GRINDING PATH

A-2.1 Cast iron shall be used as material for the grinding path. Its scaleroscope hardness shall lie between 30 and 50. This hardness shall be ascertained at least 10 times on the rim and at several points in the grinding path by means of a Shore's scaleroscope with diamond hammer.

A-2.2 The grinding path shall be a 200-mm wide annular space on the grinding disc between distances of 120 and 320 mm from the centre. The grinding path shall be repaired and restored when it has worn out by more than 0.5 mm after use or when the furrows formed in it exceed 0.2 mm in depth. When the grinding path is restored, its hardness shall be determined afresh, when irreparable it shall be changed.

A-3. ROTATION OF DISC

A-3.1 The disc shall be driven at 30 ± 1 rev/min. There shall be automatic mechanisms for counting, indicating the revolutions of the disc and for stopping the disc after every 22 revolutions. Such mechanisms shall be checked for reliability prior to the test.

A-4. HOLDING DEVICE FOR TEST SPECIMEN

A-4.1 The holding device shall consist of an open square frame made of cast iron or steel; it shall be of suitable height, with its lower edge about 5 mm above the surface of the grinding disc and so positioned that centre of the specimen is at a distance of 220 mm from the centre of the disc. It shall necessarily, but loosely, hold the specimen.

A-5. LOADING DEVICE

A-5.1 The loading may be applied directly or through a lever device. The short arm of the lever shall be provided with a counterweight just to balance the weight of the long arm and of the weighing disc, so that the pressure stamp just touches the specimen prior to the loading.

A-5.2 The lever shall move freely about the fulcrum without appreciable friction. During test, the lever shall remain nearly parallel to the upper surface of the disc. The connection of the pressure stamp to the lever shall be through a self-aligning joint permitting free relative movement but at the same time ensuring a central load on the specimen being tested.

A-5.3 Suitable loading weight shall be applied at the end of the long arm of the lever so that, as magnified by the leverage, a net load of 30 kg is applied through the pressure stamp on to the specimen. The load shall be applied with a permissible deviation of one percent. The accuracy of the load shall be verified both by calculation and by measurement with suitable instruments.

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002

Telephones: 323 0131, 323 3375, 323 9402 Fax :+ 91 11 3234062, 3239399, 3239382

E - mail : bisind @ del 2.vsnl.net.in Internet : http://wwwdel.vsnl.net.in/bis.org

Central Laboratory:

Plot No. 20/9, Site IV, Sahibabad Industrial Area, Sahibabad 201010

Telephone

91-77 00 32

Regional Offices:

Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002 323 76 17

*Eastern : 1/14 CIT Scheme VII, V.I.P. Road, Kankurgachi, CALCUTTA 700054 337 86 62

Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022 60 38 43

Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113 235 23 15

†Western : Manakalaya, E9, MIDC, Behind Marol Telephone Exchange, Andheri (East), MUMBAI 400093 832 92 95

Branch Offices:

'Pushpak', Nurmohamed Shaikh Marg, Khanpur, AHMEDABAD 380001 550 13 48

‡Peenya Industrial Area, 1st Stage, Bangalore-Tumkur Road, BANGALORE 560058 839 49 55

Commercial-cum-Office Complex, Opp. Dushera Maidan, Arera Colony, Bittan Market, BHOPAL 462016 72 34 52

62/63, Ganga Nagar, Unit VI, BHUBANESHWAR 751001 40 36 27

Kalai Kathir Building, 670 Avinashi Road, COIMBATORE 641037 21 01 41

Plot No. 43, Sector 16 A, Mathura Road, FARIDABAD 121001 91-28 88 01

Savitri Complex, 116 G.T. Road, GHAZIABAD 201001 91-71 19 98

53/5 Ward No.29, R.G. Barua Road, 5th By-lane, GUWAHATI 781003 56 65 08

5-8-56C, L.N. Gupta Marg, Nampally Station Road, HYDERABAD 500001 320 10 84

E-52, Chitaranjan Marg, C- Scheme, JAIPUR 302001 37 38 79

117/418 B, Sarvodaya Nagar, KANPUR 208005 21 68 76

Seth Bhawan, 2nd Floor, Behind Leela Cinema, Naval Kishore Road, LUCKNOW 226005 21 89 23

NIT Building, Second Floor, Gokulpat Market, NAGPUR 440010 52 51 71

Patliputra Industrial Estate, PATNA 800013 26 28 08

Institution of Engineers (India) Building 1332 Shivaji Nagar, PUNE 411005 32 36 35

'Sahajanand House' 3rd Floor, Bhaktinagar Circle, 80 Feet Road, RAJKOT 360002 26 85 86

T.C. No. 14/1421, University P. O. Palayam, THIRUVANANTHAPURAM 695034 32 72 15

*Sales Office is at 5 Chowringhee Approach, P.O. Princep Street, CALCUTTA 700072 27 10 85

†Sales Office is at Novelty Chambers, Grant Road, MUMBAI 400007 309 65 28

‡Sales Office is at 'F' Block, Unity Building, Narashimaraja Square, BANGALORE 560002 222 39 71