


इंटरनेट

मानक

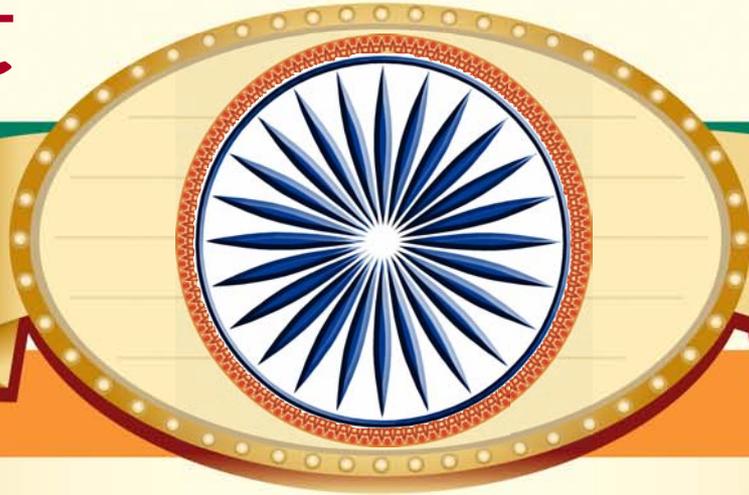

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan


“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 2547-2 (1976): gypsum building plaster, Part 2: Premixed lightweight plaster [CED 4: Building Limes and Gypsum Products]

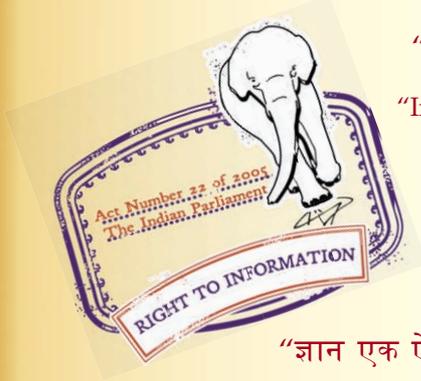

“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



IS : 2547 (Part II) - 1976
(Reaffirmed 1997)

Indian Standard

SPECIFICATION FOR
GYPSUM BUILDING PLASTERS

PART II PREMIXED LIGHTWEIGHT PLASTERS

(*First Revision*)

First Reprint FEBRUARY 1999

UDC 691.55 : 691.311

© *Copyright* 1977

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Indian Standard

SPECIFICATION FOR GYPSUM BUILDING PLASTERS

PART II PREMIXED LIGHTWEIGHT PLASTERS

(*First Revision*)

Gypsum Building Materials Sectional Committee, BDC 21

Chairman

DR S. K. CHOPRA

Representing

Cement Research Institute of India, New Delhi

Members

ADDITIONAL DIRECTOR (ARCH),
RESEARCH, DESIGNS AND
STANDARDS ORGANIZATION,
LUCKNOW

Ministry of Railways

JOINT DIRECTOR (ARCH) (*Alternate*)

SRI K. D. BHARGAVA

Directorate of Mines & Geology, Government of
Rajasthan, Jaipur

MINING ENGINEER (*Alternate*)

SRI K. K. BHATIA

All India Pottery Manufacturers' Association,
Calcutta

SRI R. K. BHATNAGAR

Shri Ram Institute for Industrial Research, Delhi

SRI C. P. SHARDA (*Alternate*)

SRI A. M. BUTT

J & K Minerals Limited, Jammu Tawi

SRI B. L. THAPPA (*Alternate*)

SRI G. J. CHANDAK

Geological Survey of India, Calcutta

SRI P. N. MEHTA (*Alternate*)

SRI J. S. FRANCISCO

Jamnagar Mineral Development Syndicate,
Jamnagar

SRI G. C. GUPTA

Delhi Development Authority, New Delhi

SRI B. B. DUTT CHOUDHARY

(*Alternate*)

SRI A. K. HAFIZKA

Asian Industries Corporation, Bombay

SRI M. P. JAIN

Office of the Development Commissioner, Small
Scale Industries, New Delhi

SRI R. K. MALIK

Directorate General of Technical Development,
New Delhi

(*Continued on page 2*)

© Copyright 1977

BUREAU OF INDIAN STANDARDS

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

IS : 2547 (Part II) - 1976

(Continued from page 1)

Members

SHRI HAZARI LAL MARWAH
SHRI AMARJIT SINGH (Alternate)
SHRI R. D. MATHUR
SHRI V. K. RAZDAN (Alternate)

SHRI D. MOHTA
SHRI L. RAMIAH
DR A. V. R. RAO
SHRI G. T. BHIDE (Alternate)
SHRI M. N. ROY

SHRI K. K. SARIN
SHRI B. G. SHARMA (Alternate)
DR S. SEN

DR S. K. GUHA (Alternate)
SHRI SOHAN LAL SINGHANIA

SHRI K. L. PAI (Alternate)
SUPERINTENDING SURVEYOR OF
WORKS (NDZ)
SURVEYOR OF WORKS I (NDZ)
(Alternate)

DR C. A. TANEJA

DR IRSHAD MASOOD (Alternate)
SHRI H. C. VERMA

SHRI M. N. BALIGA (Alternate)
SHRI D. AJITHA SIMHA,
Director (Civ Engg)

Representing

Central Builders' Association (Regd), Delhi

Ministry of Defence

Raj Plasters Ltd, Bikaner
Gypsum Industries Pvt Ltd, Tiruchirapalli
National Buildings Organization, New Delhi

Rajasthan State Mines & Minerals Limited,
Jaipur
Rajasthan Housing Board, Jaipur

Central Glass and Ceramic Research Institute
(CSIR), Calcutta

J. K. Cotton Spinning & Weaving Mills Co Ltd,
Kanpur

Central Public Works Department, New Delhi

Central Building Research Institute (CSIR),
Roorkee

Associated Instrument Manufacturers (India) Pvt
Ltd, New Delhi

Director General, ISI (Ex-officio Member)

Secretary

SHRI VINOD KUMAR
Deputy Director (Civ Engg), ISI

Indian Standard
SPECIFICATION FOR
GYPSUM BUILDING PLASTERS

PART II PREMIXED LIGHTWEIGHT PLASTERS

(First Revision)

0. FOREWORD

0.1 This Indian Standard (Part II) (First Revision) was adopted by the Indian Standards Institution on 22 December 1976, after the draft finalized by the Gypsum Building Materials Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 Gypsum is a well known building material. It has been extensively used in various countries. Premixed lightweight plasters essentially consists of gypsum plaster and lightweight aggregate which are characterized by low density, high thermal insulation and sound absorption properties and can be readily used for building purposes.

0.3 In the formulation of this standard, due weightage has been given to international co-ordination among the standards and practices prevailing in different countries in addition to relating it to the practices in the field in this country. This has been met by basing the standard on BS 1191 : Part 2 : 1973 ' Specification for gypsum building plasters. Part 2 Premixed lightweight plasters ', published by the British Standards Institution.

0.4 For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

1. SCOPE

1.1 This standard (Part II) specifies requirements for premixed lightweight plaster consisting essentially of gypsum plaster and lightweight aggregate used in general building operations.

*Rules for rounding off numerical values (revised).

2. TERMINOLOGY

2.0 For the purpose of this standard, the following definition shall apply.

2.1 Lightweight Plaster — A plaster consisting of suitable lightweight aggregates and retarded hemihydrate gypsum plasters complying with IS : 2547 (Part I)-1976*. Other additives may be incorporated to impart desired properties.

3. CLASSIFICATION

3.1 Premixed lightweight plaster may be divided into the following types:

Type A Undercoat plasters:

- a) Browning plaster,
- b) Metal lathing plaster,
- c) Bonding plaster

Type B Final coat plaster — finish plaster.

4. PHYSICAL AND CHEMICAL REQUIREMENTS OF PLASTERS

4.1 The physical and chemical requirements of the plasters shall be as given in Table 1.

5. SAMPLING

5.1 Lot — In any consignment, all the packages of the gypsum plaster of the same class and type and from the same batch of manufacture shall be grouped together to constitute a lot.

5.1.1 Samples shall be selected and tested separately from each lot to determine its conformity or otherwise to the requirements of the specification.

5.2 The number of packages to be selected for the sample from a lot shall depend upon the size of the lot and shall be in accordance with col 1 and 2 of Table 2.

5.2.1 The packages for the sample shall be selected at random from the lot and in order to ensure the randomness of selection the procedures given in IS : 4905-1968† may be adopted.

5.3 Number of Tests

5.3.1 The contents of each package in the sample shall be thoroughly homogenized by mixing separately and sufficient quantity of gypsum plaster shall then be drawn from each package separately for carrying out the tests

*Specification for gypsum building plaster; Part I Excluding premixed lightweight plasters.

†Methods for random sampling.

TABLE 1 PROPERTIES OF DIFFERENT TYPES OF PLASTERS

(Clause 4.1)

Sl. No.	PARTICULARS	UNDERCOAT PLASTERS (TYPE A)			FINAL COAT PLASTER (TYPE B), FINISH PLASTER	METHOD OF TEST, REF TO
		Browning Plaster	Metal Lathing Plaster	Bonding Plaster		
(1)	(2)	(3)	(4)	(5)	(6)	(7)
i)	Sum of soluble sodium and magnesium salt contents, expressed as percentages of sodium oxide (Na_2O), and magnesium oxide (MgO) by mass, <i>Max</i>	0.25	0.25	No upper limit	0.25	Appendix A
ii)	Dry bulk density, <i>Max</i> , kg/m^3	640	770	770	—	IS : 2542 (Part I)-1964*
iii)	Dry set density, <i>Max</i> , kg/m^3	850	1 040	1 040	—	„
iv)	Compressive strength, <i>Min</i> , N/mm^2	0.93	1.0	1.0	—	„
v)	Free lime content, by percent, mass, <i>Min</i> ,	—	2½	—	—	Appendix B
vi)	Mechanical resistance	—	—	—	Diameter of the indentation shall not be less than 4 mm and not more than 5.5 mm.	IS : 2542 (Part I)-1964*

*Method of test for gypsum plaster, concrete and products: Part I Plaster and concrete.

TABLE 2 NUMBER OF PACKAGES TO BE SELECTED FOR THE SAMPLE

(Clause 5.2)

LOT SIZE (NO. OF PACKAGES IN THE LOT)	SAMPLE SIZE (NO. OF PACKAGES TO BE SELECTED FOR THE SAMPLE)
(1)	(2)
Up to 100	3
101 „ 150	4
151 „ 300	5
301 „ 500	7
501 and above	10

IS : 2547 (Part II) - 1976

for compressive strength and free lime content. These samples of gypsum plaster drawn from each package shall be kept separately and tested individually for each of the tests mentioned above. The samples should be placed immediately in clean, dry, airtight containers for delivering to the laboratory.

5.3.2 The test for the remaining requirements shall be carried out on a composite sample prepared by thoroughly mixing equal quantities of gypsum plaster taken from each of the packages selected in the sample.

5.4 Criteria for Conformity — A lot shall be considered as conforming to the requirements of this standard if the conditions mentioned in **5.4.1** and **5.4.2** are satisfied.

5.4.1 For test results on compressive strength and free lime content, the average (\bar{X}) and the range (R) shall be calculated. From the corresponding average and range value for each characteristic the value of the expressions $\bar{X} \pm 0.4 R$ shall be calculated. The value of the expression $\bar{X} - 0.4 R$ as calculated above should be greater than or equal to the minimum limits specified, and the value of the expression $\bar{X} + 0.4 R$ shall be less than or equal to the maximum limit specified.

5.4.2 All the test results for remaining requirements tested on the composite sample shall satisfy the corresponding specification requirements.

6. MARKING

6.1 The vendor shall show clearly on each package of plaster name of the manufacturer, the type to which the plaster belongs, the date of manufacture and the net mass. In addition, it shall be clearly indicated whether the plaster is to be used as an undercoat or final coat.

6.1.1 The product may also be marked with Standard mark.

6.2 The use of the Standard Mark is governed by the provisions of the *Bureau of Indian Standards Act, 1986* and the Rules and Regulations made thereunder. The details of conditions under which the licence for the use of Standard Mark may be granted to manufacturers or producers may be obtained from the Bureau of Indian Standards.

APPENDIX A

(Table 1)

DETERMINATION OF SOLUBLE MAGNESIUM OXIDE AND SODIUM OXIDE CONTENT IN GYPSUM BUILDING PLASTER

A-1. PREPARATION OF THE SAMPLE SOLUTION

A-1.1 Weigh 25 g of sample into a 400-ml beaker and add 250 ml of water. Stir thoroughly and let stand for 30 minutes at room temperature. Stir again and filter immediately through a Buchner funnel, which contains a well-seated retentive filter paper, into a 500-ml filtering flask using slight vacuum. Without washing, transfer the insoluble matter and the paper to the original beaker and rinse the funnel with 150 ml of water into the beaker containing the insoluble matter. Stir thoroughly and let stand 30 min at room temperature. Stir and filter, as above, using a fresh filter paper. Again return the insoluble matter and the paper to the original beaker. Wash the funnel with 100 ml of water into the beaker containing the insoluble matter. Stir thoroughly and let stand for 30 minutes at room temperature. Stir and filter as above. Quantitatively transfer the filtrate to a suitable beaker. Acidify the filtrate with 5 ml of concentrated hydrochloric acid (r. d. 1.19). Stir until cloudiness disappears. Evaporate the solution to about 400 ml. Cool to room temperature and transfer quantitatively to a 500-ml volumetric flask. Dilute to 500 ml.

A-1.2 Determination of Soluble MgO — Determination of soluble magnesium oxide is specified in 12 of IS : 1760-1962* except that 200 ml of sample solution is taken and calcium precipitated according to 9.3 of IS : 1760-1962* and the filtrate from calcium estimation is used for the determination of magnesium. The calculations may be modified as:

$$\text{Magnesium oxide (MgO), percent} = \frac{A \times 0.1291 \times 2.5 \times 100}{B}$$

where

A = mass in g of oxinate, and

B = mass in g of the sample.

A-1.3 Determination of Soluble Sodium Salt as Sodium Oxide — The estimation of soluble sodium oxide is done as specified in 4.11 of IS : 4032-1968† except that 50 ml of the sample solution is taken in a 100-ml

*Methods of chemical analysis of limestone, dolomite and allied materials.

†Method of chemical analysis of hydraulic cement.

flask. To this is added 9 ml of 63 000 ppm calcium oxide solution and the volume made up to 100 ml. The calculation for the sodium oxide may be modified as:

$$\text{Sodium oxide (Na}_2\text{O), percent} = \frac{A}{W \times 10}$$

where

A = parts per million of sodium oxide in the solution, and

W = mass in g of the sample.

APPENDIX B

(Table 1)

DETERMINATION OF FREE LIME

Suspend 5 g of the sample in approximately 100 ml of distilled water. Add several drops of phenolphthalein indicator solution (0.5 percent in 50 percent aqueous ethanol) and titrate with 0.50 N hydrochloric acid until the pink colour of the indicator just disappears. Continue the titration until the pink colour does not return after standing for two to three minutes.

With 5 g sample, 1 ml 0.50 N acid \equiv 0.37 percent Ca(OH)₂.

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002

Telephones: 323 0131, 323 3375, 323 9402

Fax : 91 11 3234062, 91 11 3239399, 91 11 3239382

Telegrams : Manaksanstha
(Common to all Offices)

Central Laboratory:

Plot No. 20/9, Site IV, Sahibabad Industrial Area, SAHIBABAD 201010

Telephone
8-77 00 32

Regional Offices:

Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002	323 76 17
*Eastern : 1/14 CIT Scheme VII M, V.I.P. Road, Maniktola, CALCUTTA 700054	337 86 62
Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022	60 38 43
Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113	235 23 15
†Western : Manakalaya, E9 Behind Marol Telephone Exchange, Andheri (East), MUMBAI 400093	832 92 95

Branch Offices:

'Pushpak', Nurmohamed Shaikh Marg, Khanpur, AHMEDABAD 380001	550 13 48
‡Peenya Industrial Area, 1st Stage, Bangalore - Tumkur Road, BANGALORE 560058	839 49 55
Gangotri Complex, 5th Floor, Bhadbhada Road, T. T. Nagar, BHOPAL 462003	55 40 21
Plot No. 62-63, Unit VI, Ganga Nagar, BHUBANESHWAR 751001	40 36 27
Kalaikathir Buildings, 670 Avinashi Road, COIMBATORE 641037	21 01 41
Plot No. 43, Sector 16 A, Mathura Road, FARIDABAD 121001	8-28 88 01
Savitri Complex, 116 G. T. Road, GHAZIABAD 201001	8-71 19 96
53/5 Ward No. 29, R. G. Barua Road, 5th By-lane, GUWAHATI 781003	54 11 37
5-8-58C, L. N. Gupta Marg, Nampally Station Road, HYDERABAD 500001	20 10 83
E-52, Chitaranjan Marg, C-Scheme, JAIPUR 302001	37 29 25
117/418 B, Sarvodaya Nagar, KANPUR 208005	21 68 76
Setch. Bhavan, 2nd Floor, Behind Leela Cinema, Naval Kishore Road, LUCKNOW 226001	23 89 23
Patliputra Industrial Estate, PATNA 800013	26 23 05
T. C. No. 14/1421, University P. O. Palayam, THIRUVANANTHAPURAM 695034	6 21 17
NIT Building, Second Floor, Gokulpat Market, NAGPUR 440010	52 51 71
Institution of Engineers (India) Building, 1332 Shivaji Nagar, PUNE 411005	32 36 35
*Sales Office is at 5 Chowringhee Approach, P. O. Princep Street, CALCUTTA 700072	27 10 85
†Sales Office is at Novelty Chambers, Grant Road, MUMBAI 400007	309 65 28
‡Sales Office is at 'F' Block, Unity Building, Narashimaraja Square, BANGALORE 560002	222 39 71

**AMENDMENT NO. 1 JULY 2011
TO
IS 2547 (PART 2) : 1976 SPECIFICATION FOR GYPSUM BUILDING
PLASTER**

PART 2 PREMIXED LIGHTWEIGHT PLASTER

(First Revision)

(Page 4, clause 2.1) — Substitute the following for the existing:

‘2.1 Lightweight Plaster — A plaster consisting of suitable lightweight aggregates and retarded hemihydrate gypsum plasters complying with IS 2547 (Part 1) : 1976*. Expanded perlite and exfoliated vermiculite may also be added. Other additives may be incorporated to impart desired properties.’

[Page 4, clause 3.1(c)] — Substitute the following for the existing:

‘c) Bonding plaster, and
d) Ready-mixed plaster.’

[Page 5, Table 1, Sl No. (ii), col 7] — Substitute the following for the existing entry:

‘IS 2542 (Part 1) : 1978*’

[Page 5, Table 1, Sl No. (vi), col 7] — Substitute the following for the existing entry:

‘IS 2542 (Part 1) : 1978*’

(Page 5, Table 1, footnote) — Substitute the following for the existing:

‘*Methods of test for gypsum plaster, concrete and products: Part 1 Plaster and concrete (*first revision*) (Section 1 to 12).’

(Page 7, clause A-1.3, line 3) — Substitute ‘IS 4032 : 1985†’ for ‘IS : 4032 - 1968†’.

(Page 7, footnote marked †) — Substitute the following for the existing:

‘Method of chemical analysis of hydraulic cement (*first revision*).’

(CED 4)